


SRV20947



- * **WU:** old HTL DSI units
- * **Vendor:** Edwards
- * UL Listed Class 2
- * CSA Certified Class 2
- * 120 V
- * 50/60 HZ
- * 24V< 20VA> connections on back of transformer
- * Cat# 592


SRV20947 Info 2.4.13 bp

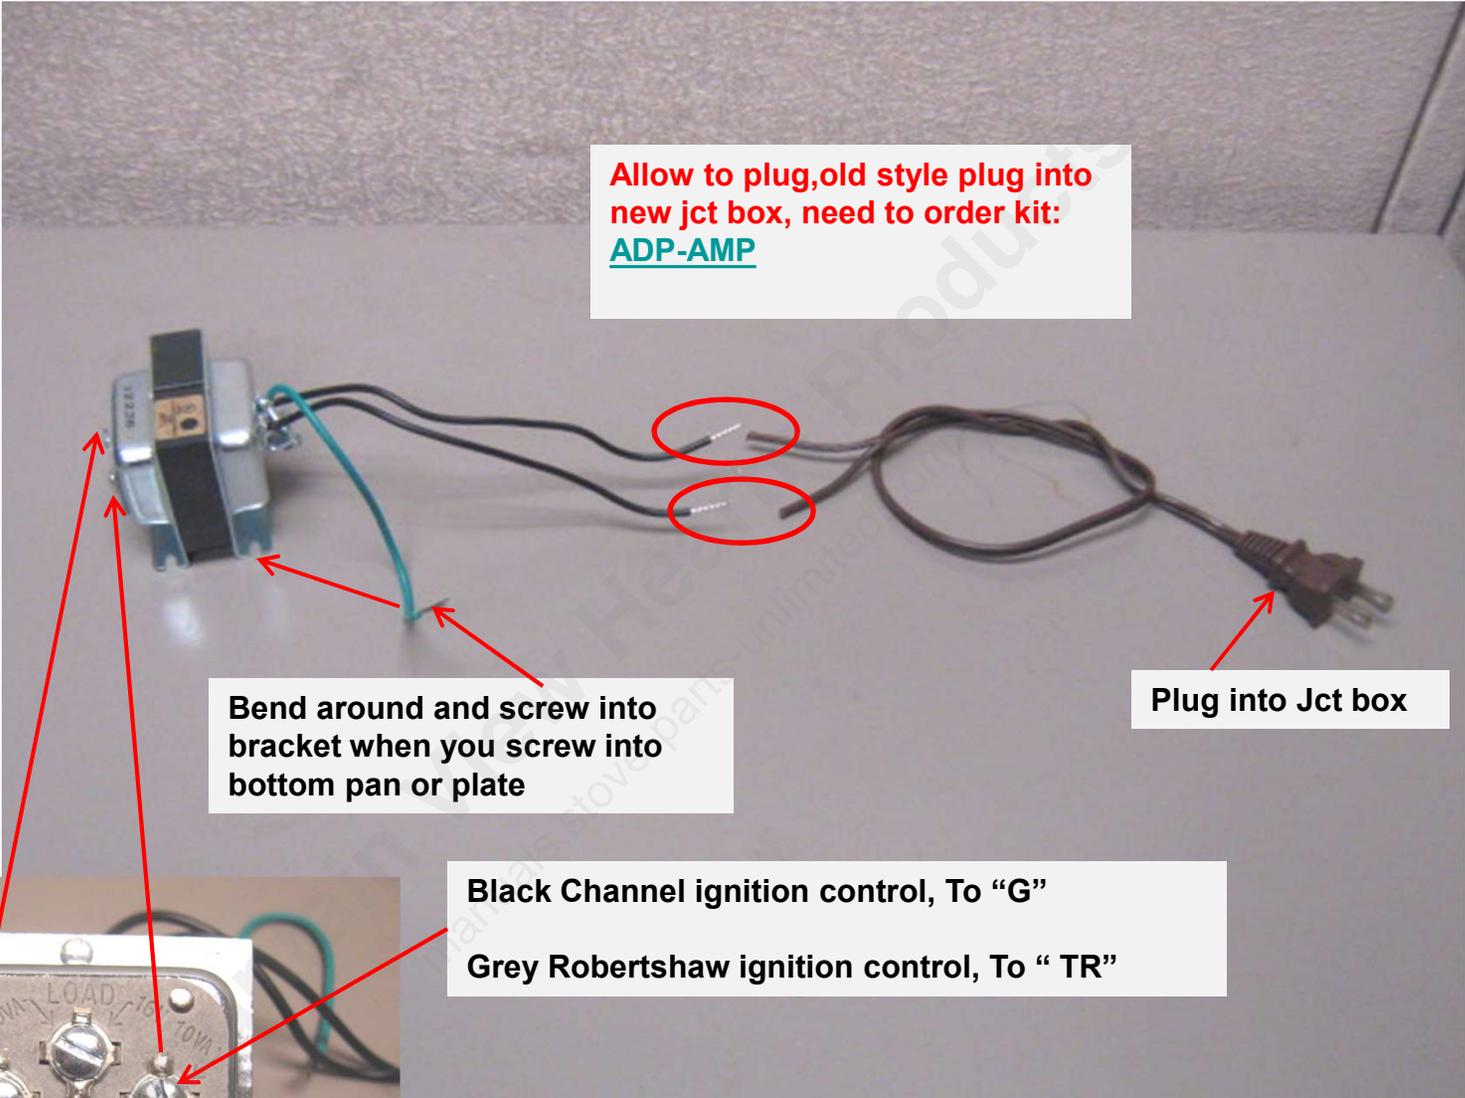

Allow to plug, old style plug into new jct box, need to order kit: [ADP-AMP](#)

Bend around and screw into bracket when you screw into bottom pan or plate

Plug into Jct box

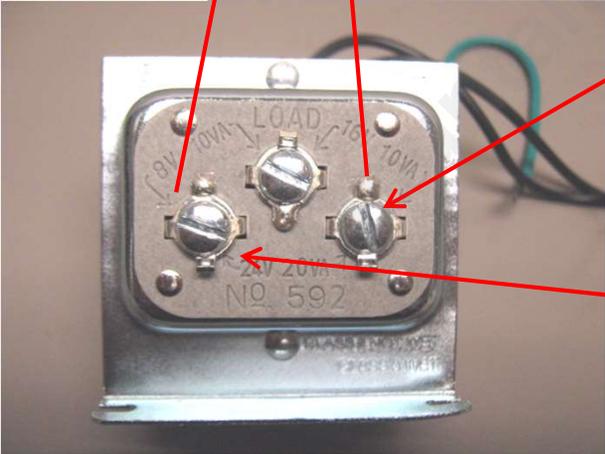

Black Channel ignition control, To "G"
Grey Robertshaw ignition control, To "TR"

Black Channel ignition control, To "High limit switch wire"
Grey Robertshaw ignition control, To " High limit switch wire"

SRV20947 Info 2.4.13 bp

If plugging into old jct box

.. need to order KIT: will allow to plug new transformer into old style jct box
[ADP-AMPJCTBOX](#)

Will not use this

Bend around and screw into bracket when you screw into bottom pan or plate

Black Channel ignition control, To "G"

Grey Robertshaw ignition control, To "TR"

Black Channel ignition control, To "High limit switch wire"

Grey Robertshaw ignition control, To " High limit switch wire"

SRV20947 Info 2.4.13 bp






SRV20947 Info 2.4.13 bp





SRV20947 Info 2.4.13 bp

Transformer # 20947

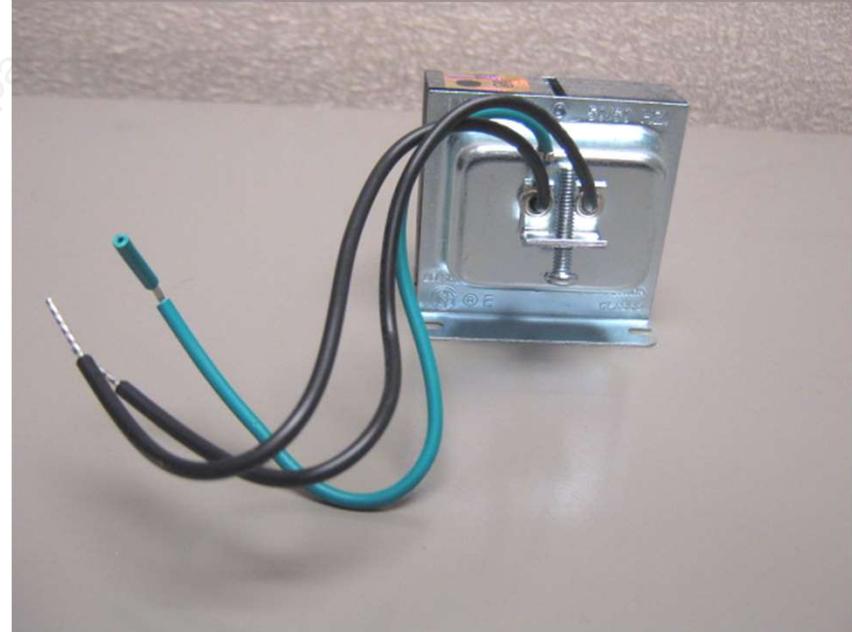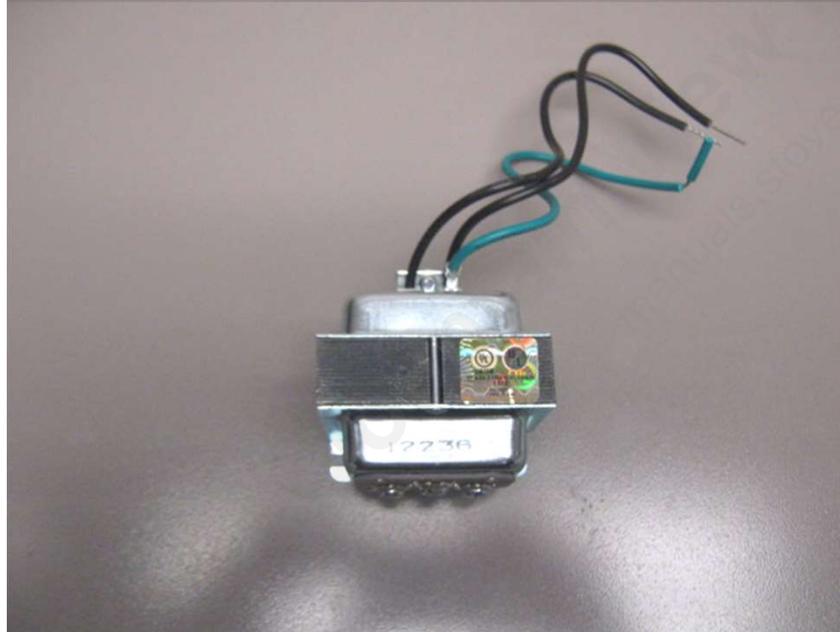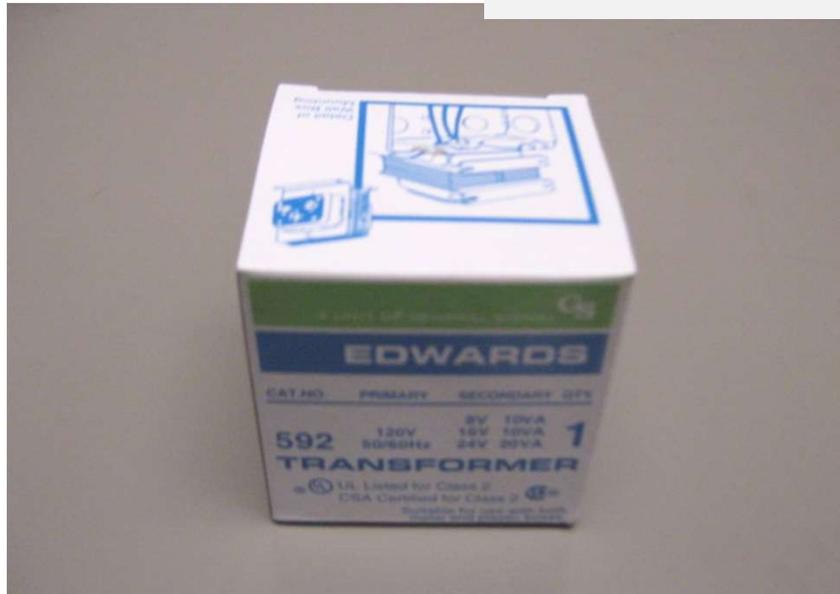

SRV20947 Info 2.4.13 bp

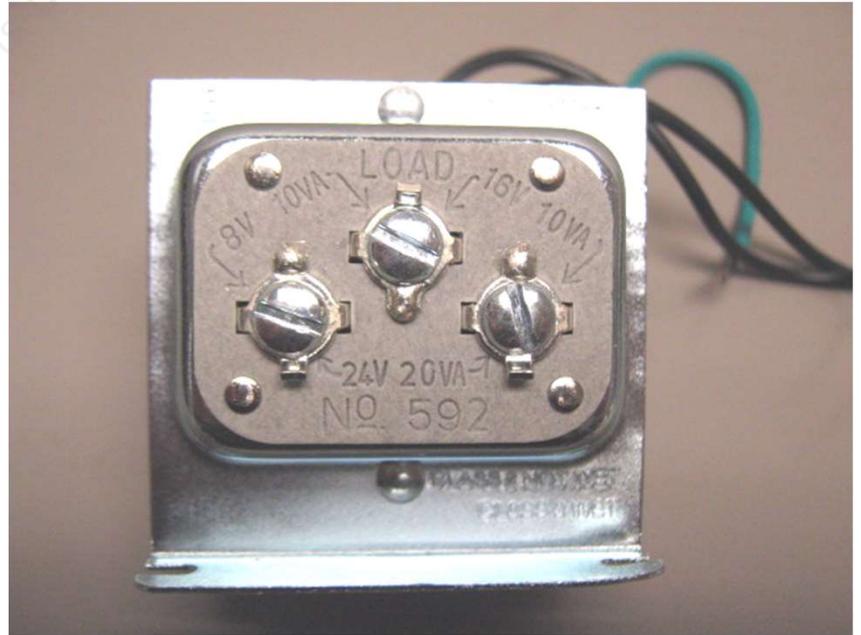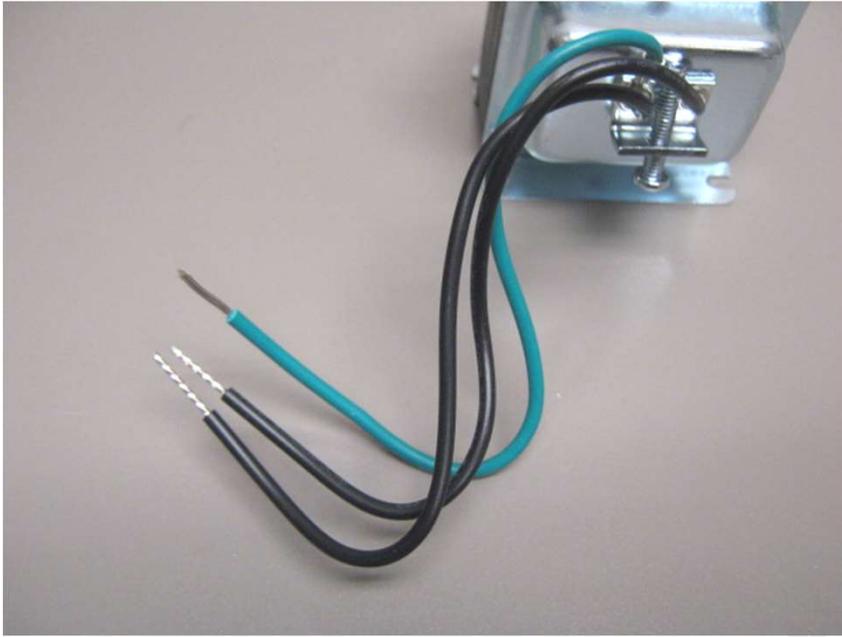

SRV20947 Info 2.4.13 bp